



产品认证证书


证书编号: CQC2002010308025029

申请人名称及地址

浙江天正电气股份有限公司
浙江省乐清市柳市镇苏吕工业区

制造商名称及地址

浙江天正电气股份有限公司

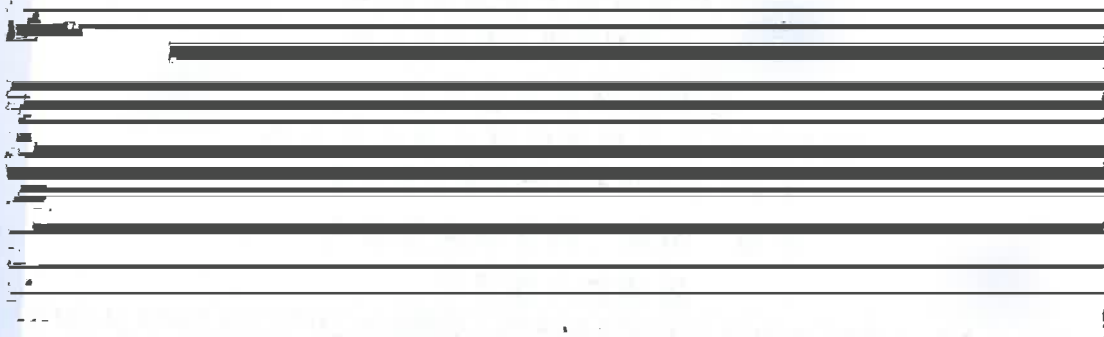

浙江省乐清市柳市镇苏吕工业区

生产企业名称及地址

浙江天正电气股份有限公司 (V024163)
浙江省乐清市柳市镇柳乐路 332 号

产品名称和系列、规格、型号

刀型触头熔断器

RT16Z-A3,RT16Z-A3G,RT16Z-3G,RT16Z-3,RT16-A3,RT16-A3G,RT16-3G,RT16-3; 参数详见附件

产品标准和技术要求

主任



中国质量认证中心

中国 北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

C 0376988



CERTIFICATE NO.: CQC2002010308025029

NAME AND ADDRESS OF THE APPLICANT

Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang Province, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang Province, P.R.China

NAME AND ADDRESS OF THE FACTORY

Zhejiang Tengen Electric Co.,Ltd. (V024163)
No.332 Liule Road, Liushi Town, Yueqing City, Zhejiang Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Fuses with fuse-links with blade contacts
RT16Z-A3,RT16Z-A3G,RT16Z-3G,RT16Z-3,RT16-A3,RT16-A3G,RT16-3G,RT16-3; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 13539.2-2015

TYPE OF CERTIFICATION SCHEMES

Type testing+Follow up factory inspection

This is to certify that the above mentioned product(s) complies with the requirements of certification rules of CQC11-462141-2019 .

Valid from: Aug.24,2020

Valid until: Nov.20,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China
<http://www.cqc.com.cn>

C 0376988



产品认证证书

附 录

第 1 页 共 1 页

证书编号: CQC2002010308025029

纸 号: 376988

熔断体型号

RT16Z-A3,RT16Z-A3G,RT16Z-3G,RT16Z-3,RT16-A3,RT16-A3G,RT16-3G,RT16-3,

熔断体的额定电压 U_n : AC500V/AC690V,DC440V;

熔断体的额定电流 I_n : 315A,400A,500A,630A(AC500/690V,DC440V),800A(AC690V);

额定短路能力 I_1 : 315-630A:120kA/AC500V,50kA/AC690V,100kA/DC440V;

800A:100kA/AC690V;

分断范围和使用类别: gG;

熔断器支持件型号: RT16- 3,RT16Z- 3;

熔断器支持件的额定电压 U_n : AC690V(RT16- 3,RT16Z- 3),DC440V(RT16Z- 3);

熔断器支持件的额定冲击耐受电压 U_{imp} : 6kV;

熔断器支持件的额定电流 I_n : 800A;

极数: 1P.

主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>

